


NON-PAVED AREAS

PRECAST SHOULDER SLAB
SEE DETAIL

2' X 2' X 12" THICK
CONCRETE VALVE BOX
STABILIZATION PAD

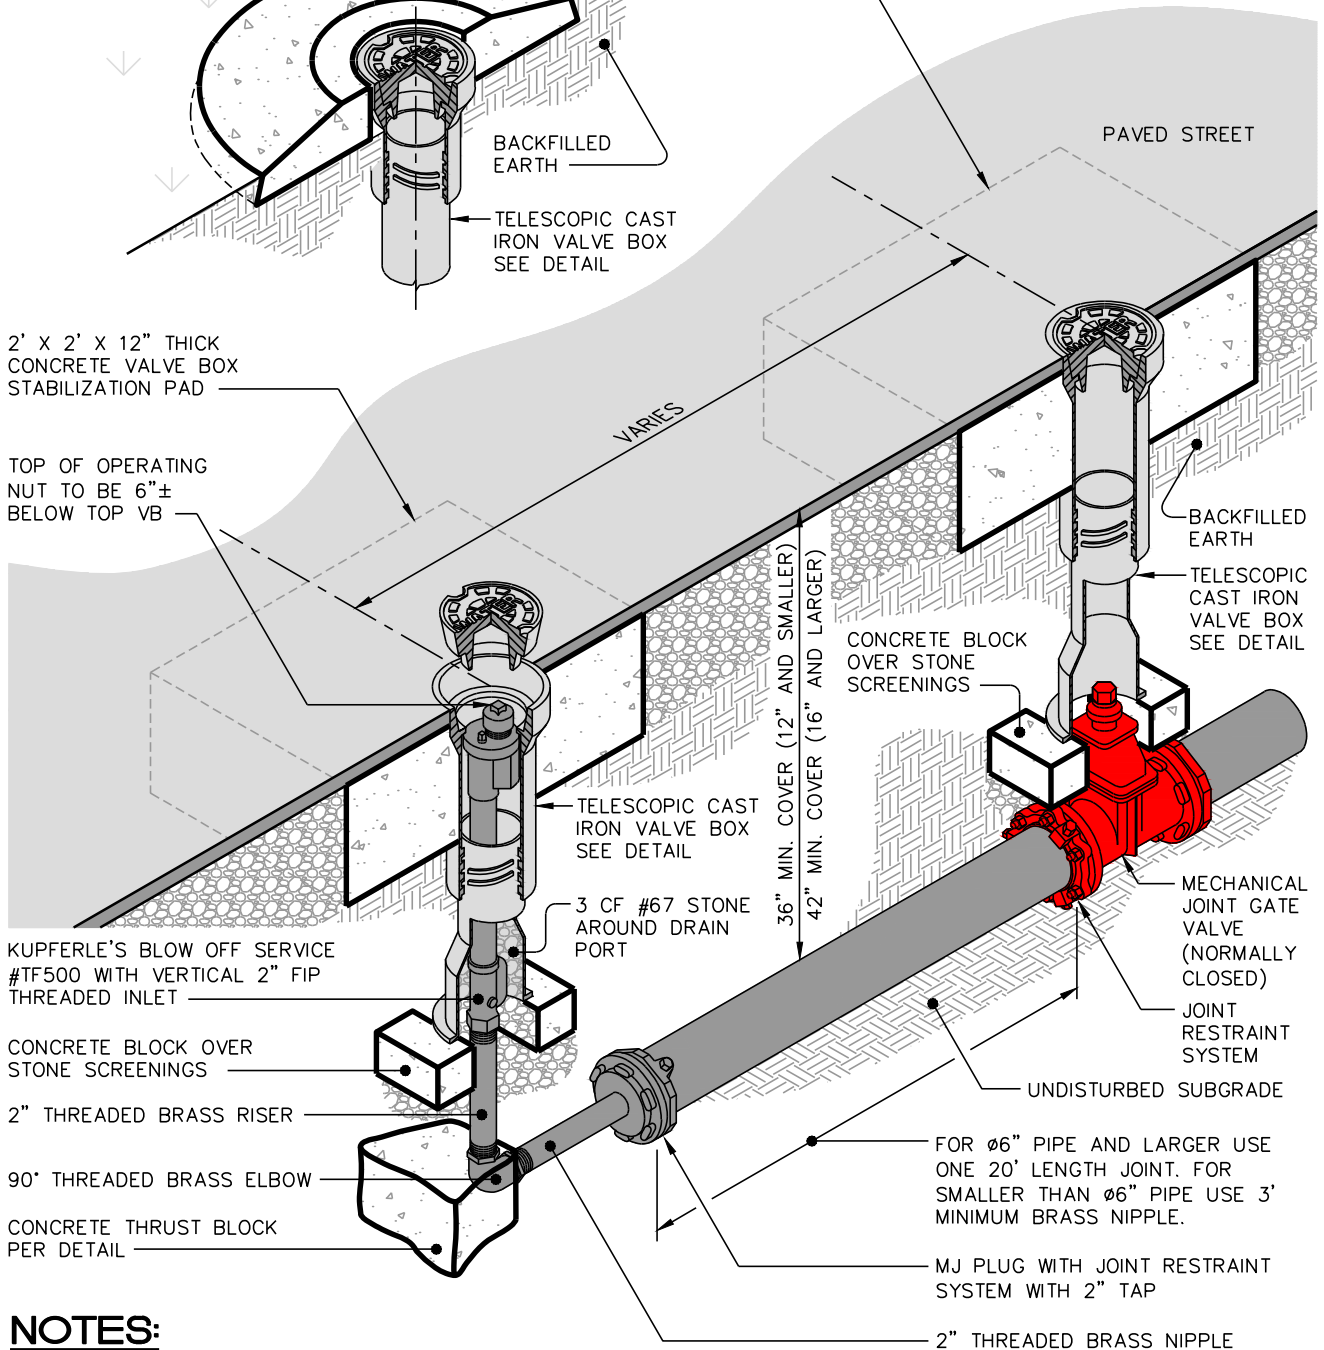

NOTES:

1. NO DISCHARGE FROM BLOW-OFF SHOULD GO DIRECTLY INTO A CREEK. DECHLORINATE DISCHARGE BEFORE IT ENTERS A BODY OF WATER.
2. PROVIDE EROSION AND SEDIMENTATION CONTROLL FOR DISCHARGE.
3. ENCASE TAP, BRASS PIPE, ELBOW, AND BLOW OFF DRAIN PORT WITH 3 CF #67 STONE.



TITLE:	2' BLOW-OFF ASSEMBLY FOR MAINS UP TO 12'	REV DATE:	7/31/15	DWG NO:	W.009
PO BOX 1436 900 S. BECKFORD DRIVE HENDERSON, NC 27536	CITY OF HENDERSON	252-430-5728 (fax) 252-431-0124 www.ci.henderson.nc.us	SCALE:	NTS	SHEET #: 1 OF 1